



**ROANOKE RAPIDS FIRE DEPARTMENT  
ROANOKE RAPIDS, NC**

S.O. 145880 / Q116919

**PUMPER  
TYPHOON 4X2 CHASSIS**



1500 GPM HALE QMAX PUMP		HOSE LOAD:	
760 GALLON WATER TANK		200' OF 2.50" DJ	
		1000' OF 5.00" LDH	
COMPT.	OPENING	INTERIOR DIMENSION	
L1	28W 59H	30W 39H	73 D UPPER
R1	28W 59H	30W 39H	73 D LOWER
L2	54W 25H	56W 25H	12 D LOWER
R2	54W 25H	56W 25H	12 D
L3	48W 59H	50W 39H	71 D UPPER
R3	48W 59H	50W 39H	71 D LOWER
B1	36W 46H	38W 55H	27 D

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES.  
(FOR INTERNAL SALES PURPOSES ONLY)

AS IS  
 WITH REVISIONS

*MA*

HOSEBED HEIGHT:  
(FOR REFERENCE ONLY)  
TO TAILBOARD: 67"  
TO GROUND: 96±2"

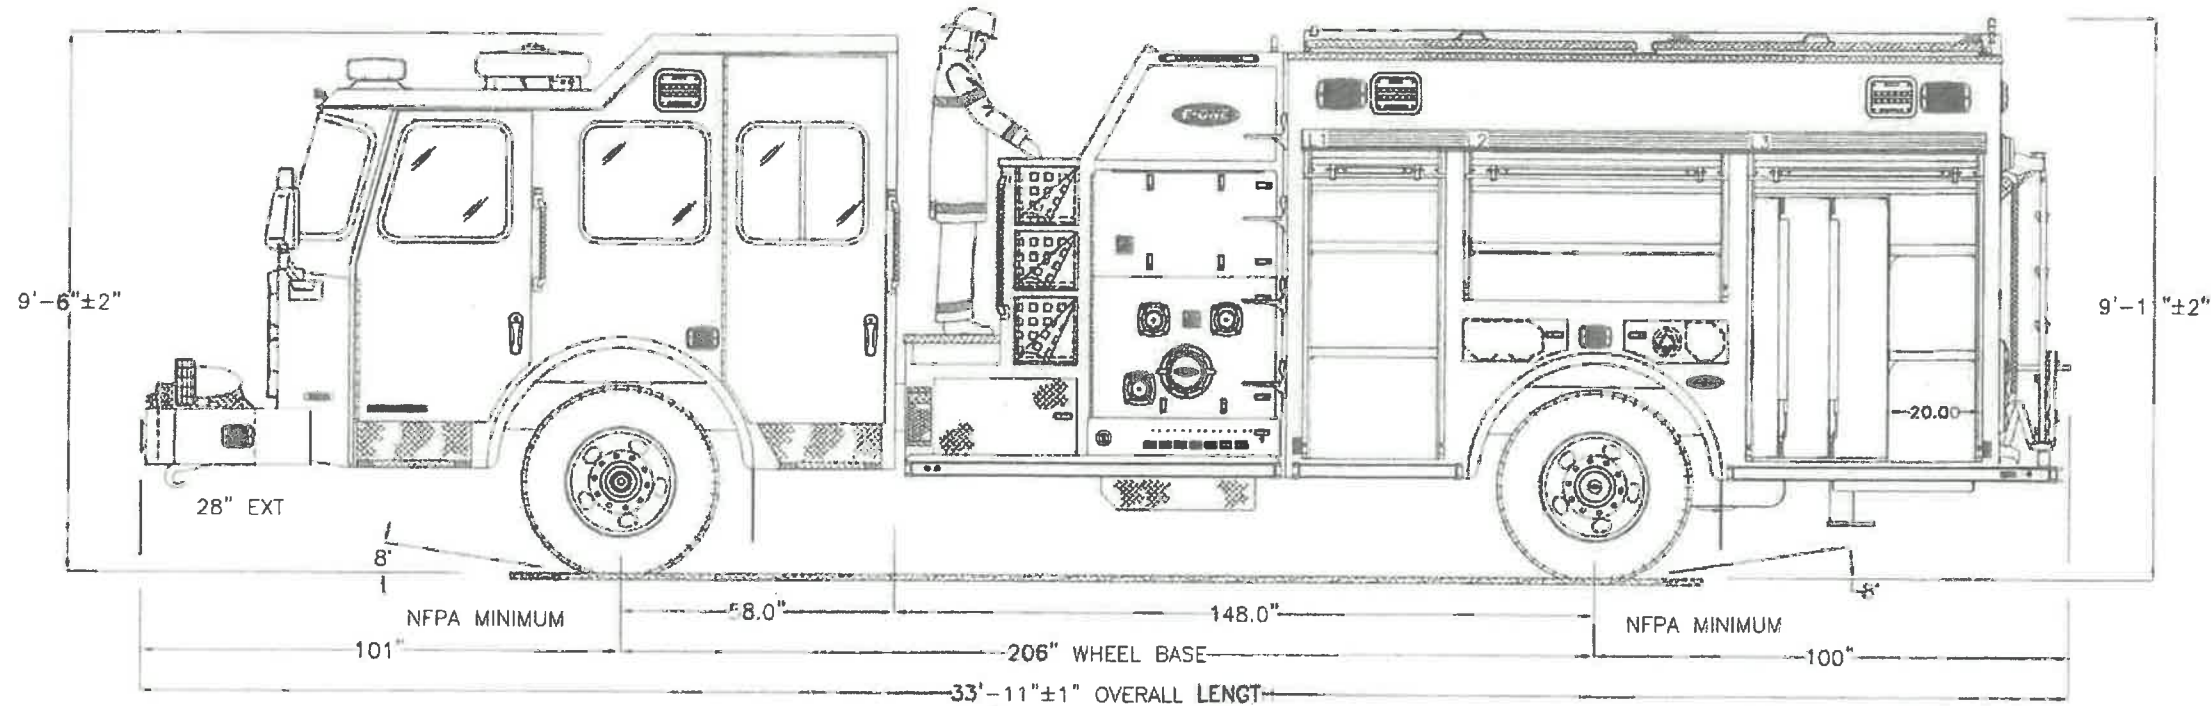
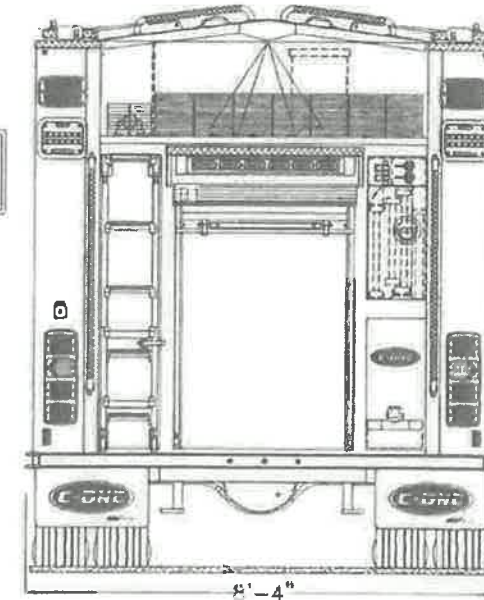




ROANOKE RAPIDS FIRE DEPARTMENT  
ROANOKE RAPIDS, NC  
S.O. 145880 / Q116919  
PUMPER  
TYPHOON 4X2 CHASSIS

THIS DRAWING IS FOR REFERENCE PURPOSES. ALL DIMENSIONS ARE  
SUBJECT TO MINOR VARIATIONS DUE TO MANUFACTURING PROCESSES  
(FOR INTERNAL SALES PURPOSES ONLY)  
DATE: 11/15/12 BY: [Signature] CAS IS  
EQUIPMENT APPROVAL: [Signature] E-ONE REVISIONS

*MA*

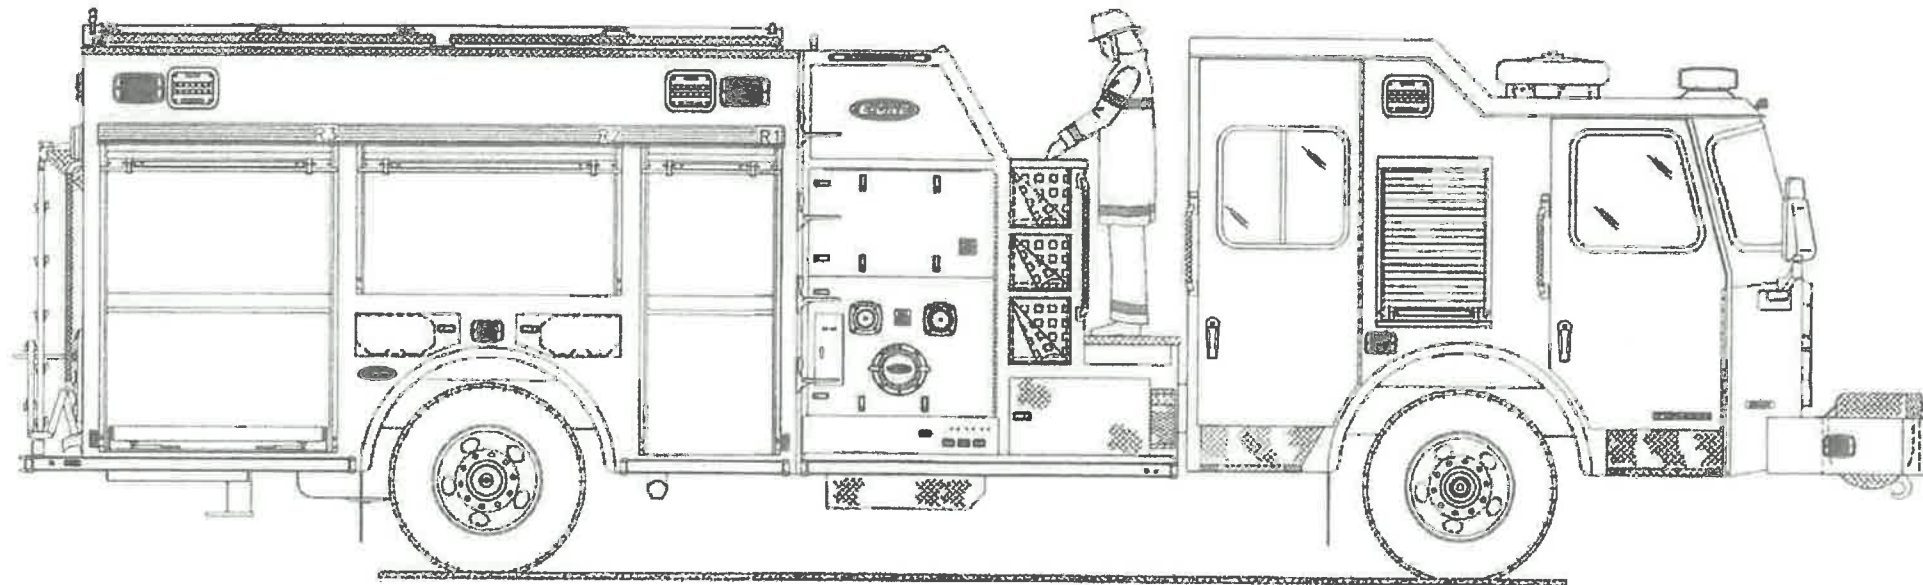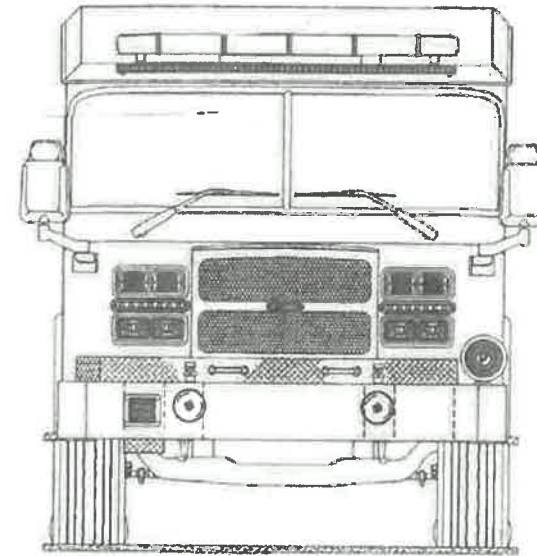

DATE	BY	DATE	BY	DATE	BY
11/15/12	[Signature]				